
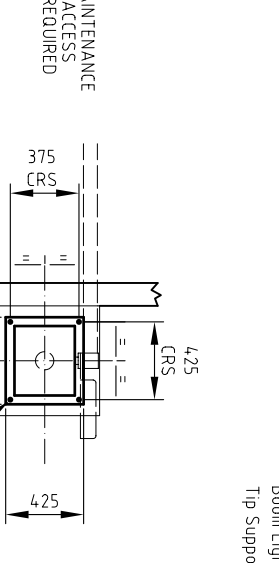



NOTE A:
 CONCRETE TO BE CAST A MINIMUM
 OF 7 DAYS BEFORE INSTALLATION OF EQUIPMENT.
 (GRADE C32/40 - 20mm GRAVEL)

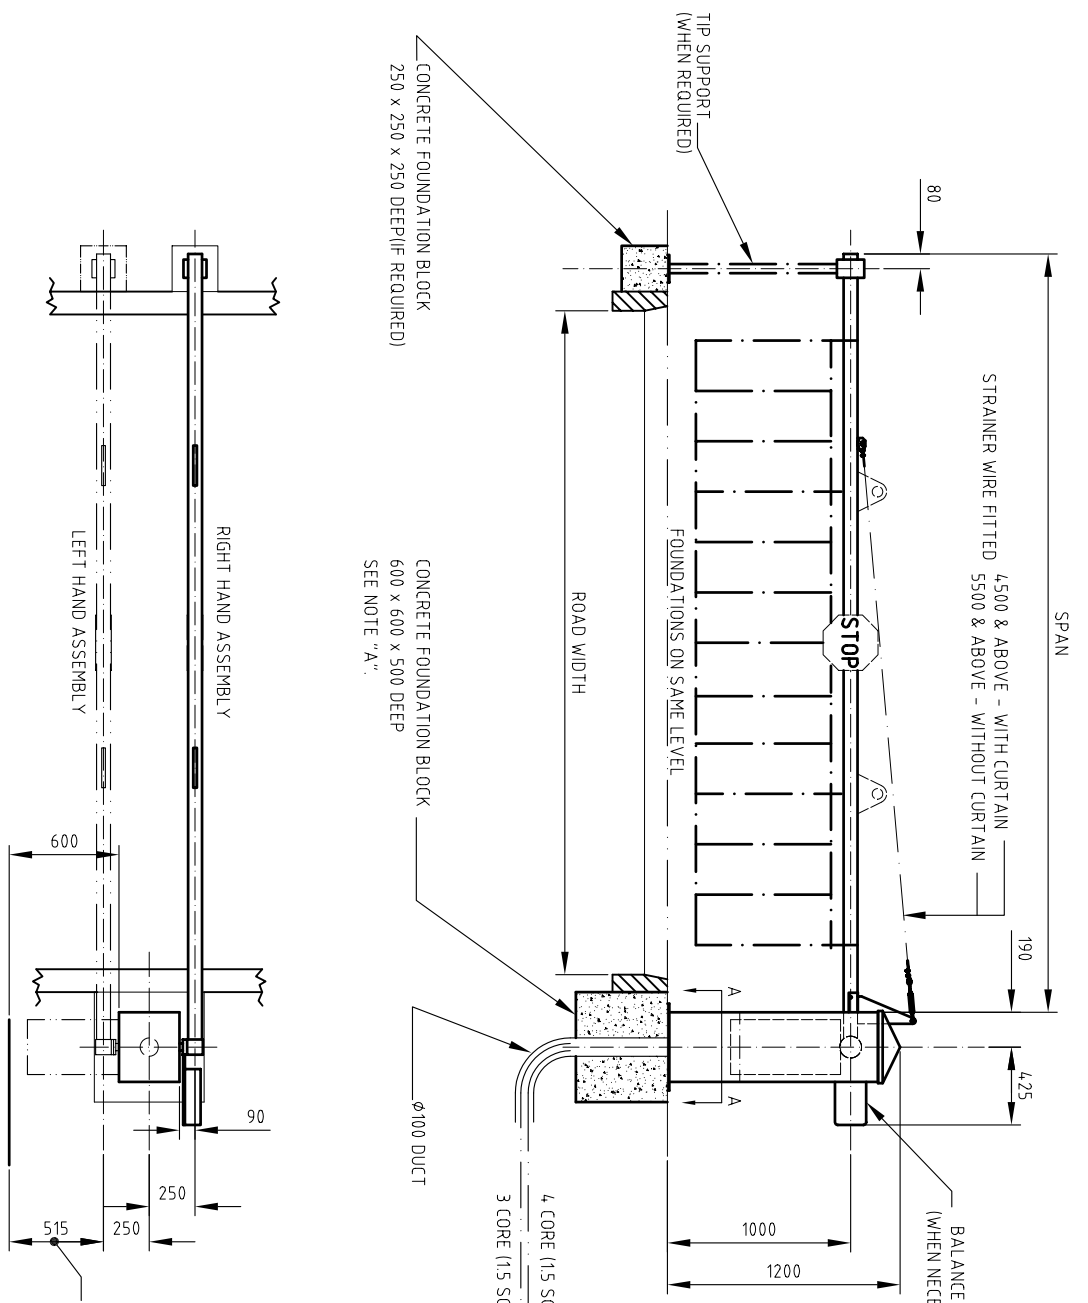

ELECTRICAL SPECIFICATION:
 Voltage (V) : 230
 Frequency (Hz) : 50
 Load Current (A) : 6
 Rating (Kw) : 0.37

OPTIONAL ACCESSORIES SHOWN:
 PVC Curtain
 Stop Signs
 Boom Lights
 Tip Support Post

THIS DRAWING REMAINS OUR
 PROPERTY & MAY NOT BE COPIED
 OR PASSED TO A THIRD PARTY
 WITHOUT OUR WRITTEN CONSENT



NEWGATE (Nework) LTD
 BRUNEL DRIVE, NEWARK, NOTTS NG24 2QE
 TEL: 01529 231772 & 736500
 FAX: 01529 605400

Issue	Date	Mod no.	Description	Drawn By	Ref. no.	Ant.	Part name	Material	Dimension	Remark
8	15/11/01	1	BARRIER FIXING DETAIL ADDED CONCRETE SHALL UPDATED	SRK SRK	THE OUTLINE - CHALLENGER BARRIER					
IF IN DOUBT - STOP - ASK !					06/1/00	MC			1:30	102/3/17315