


ø 75 DUCT
DIRECTION TO SUIT SITE
(BOTH SIDES IF REQUIRED)

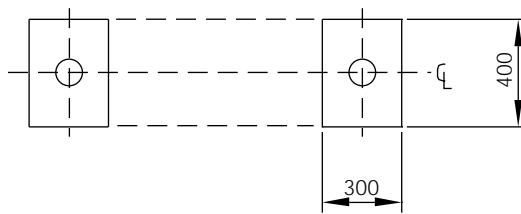

PED GATE

HEIGHT TO SUIT CONTRACT (STANDARD = 2000mm)
WIDTH TO SUIT CONTRACT (STANDARD = 1000mm)

INFILL OPTIONS (SIZES TO SUIT CONTRACT)

- BAR (RHS/TUBE)
- WELDMESH
- BAR/WELDMESH
- PALISADE

OPTIONAL EXTRAS

- ELECTRO/MECHANICAL LOCK (STD) -1
- SELF CLOSER -2
- MAGNETIC LOCK -3
- ELECTRO/HYDRAULIC OPERATOR -4
- MANUAL (NO ELECS)
- CARD READERS
- INTERCOM SYSTEMS
- BARBED WIRE/CAPPING
- FINISH TO SUIT CONTRACT

FOUNDATIONS

CONCRETE TO BE GRADE C25 OPC 20mm
GRAVEL AND CAST A MINIMUM OF 7 DAYS
BEFORE INSTALLATION. THE GATE
PADS MUST BE FLAT AND LEVEL WITH EACH OTHER.
FOUNDATION MAY BE A CONTINUOUS BLOCK
IF DESIRED. (MUST BE FLAT AND LEVEL)