

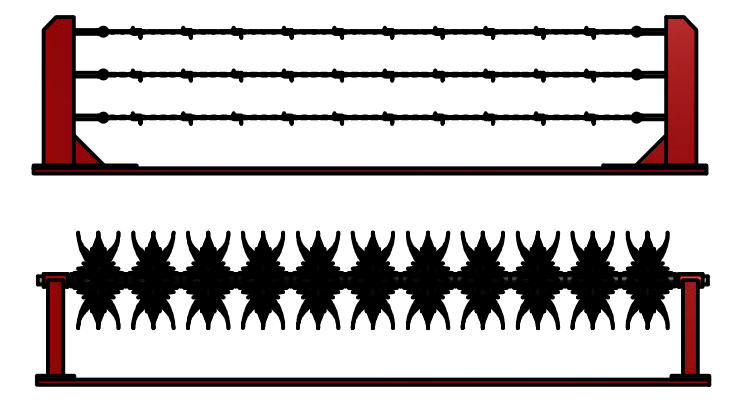


CAPPING OPTIONS:
ROTA SPIKES, BARBED WIRE

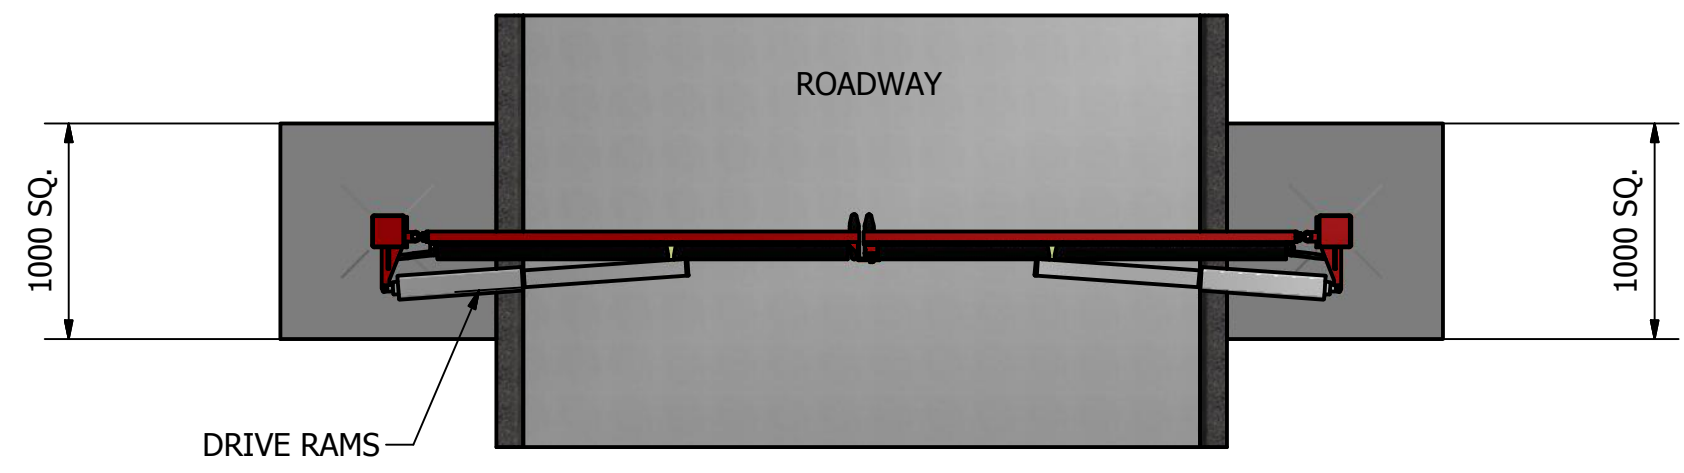

INFILL OPTIONS:

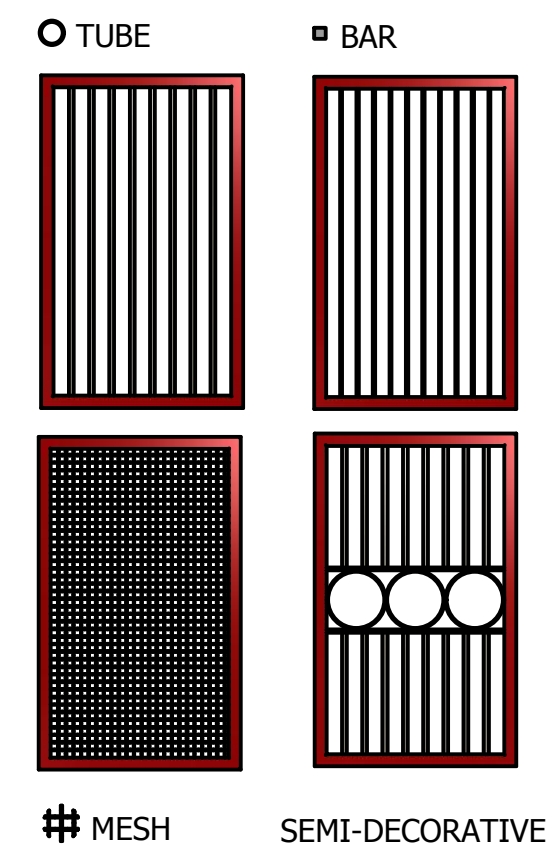

ELECTRICAL SPECIFICATION:
MAGLOCK : 24V.D.C. 480mA
CONTROL PANEL : 230V.A.C, 1A

FOUNDATIONS:
CONCRETE TO BE CAST A MINIMUM OF 7 DAYS BEFORE
INSTALLATION OF EQUIPMENT.
(GRADE C32/40 20mm AGGREGATE)
BOTH FOUNDATIONS SHOULD BE SMOOTH, FLAT AND
LEVEL WITH EACH OTHER.

±1.0mm UOS	Finish AS PER CONTRACT		
DESIGNED BY josephs	MATERIAL AS PER CONTRACT	DATE 15/02/13	
NEWGATE (NEWARK) LTD BRUNEL DRIVE, NEWARK, NOTTS. NG24 2DE TELEPHONE 01636 700172 EMAIL SALES@NEWGATE.UK.COM		TITLE LAYOUT - ELECTRIC SWING GATES (UP TO 4.5m)	
PART No 107-3-37465		ISSUE	SHEET 1 / 1